


REVISION No. 9

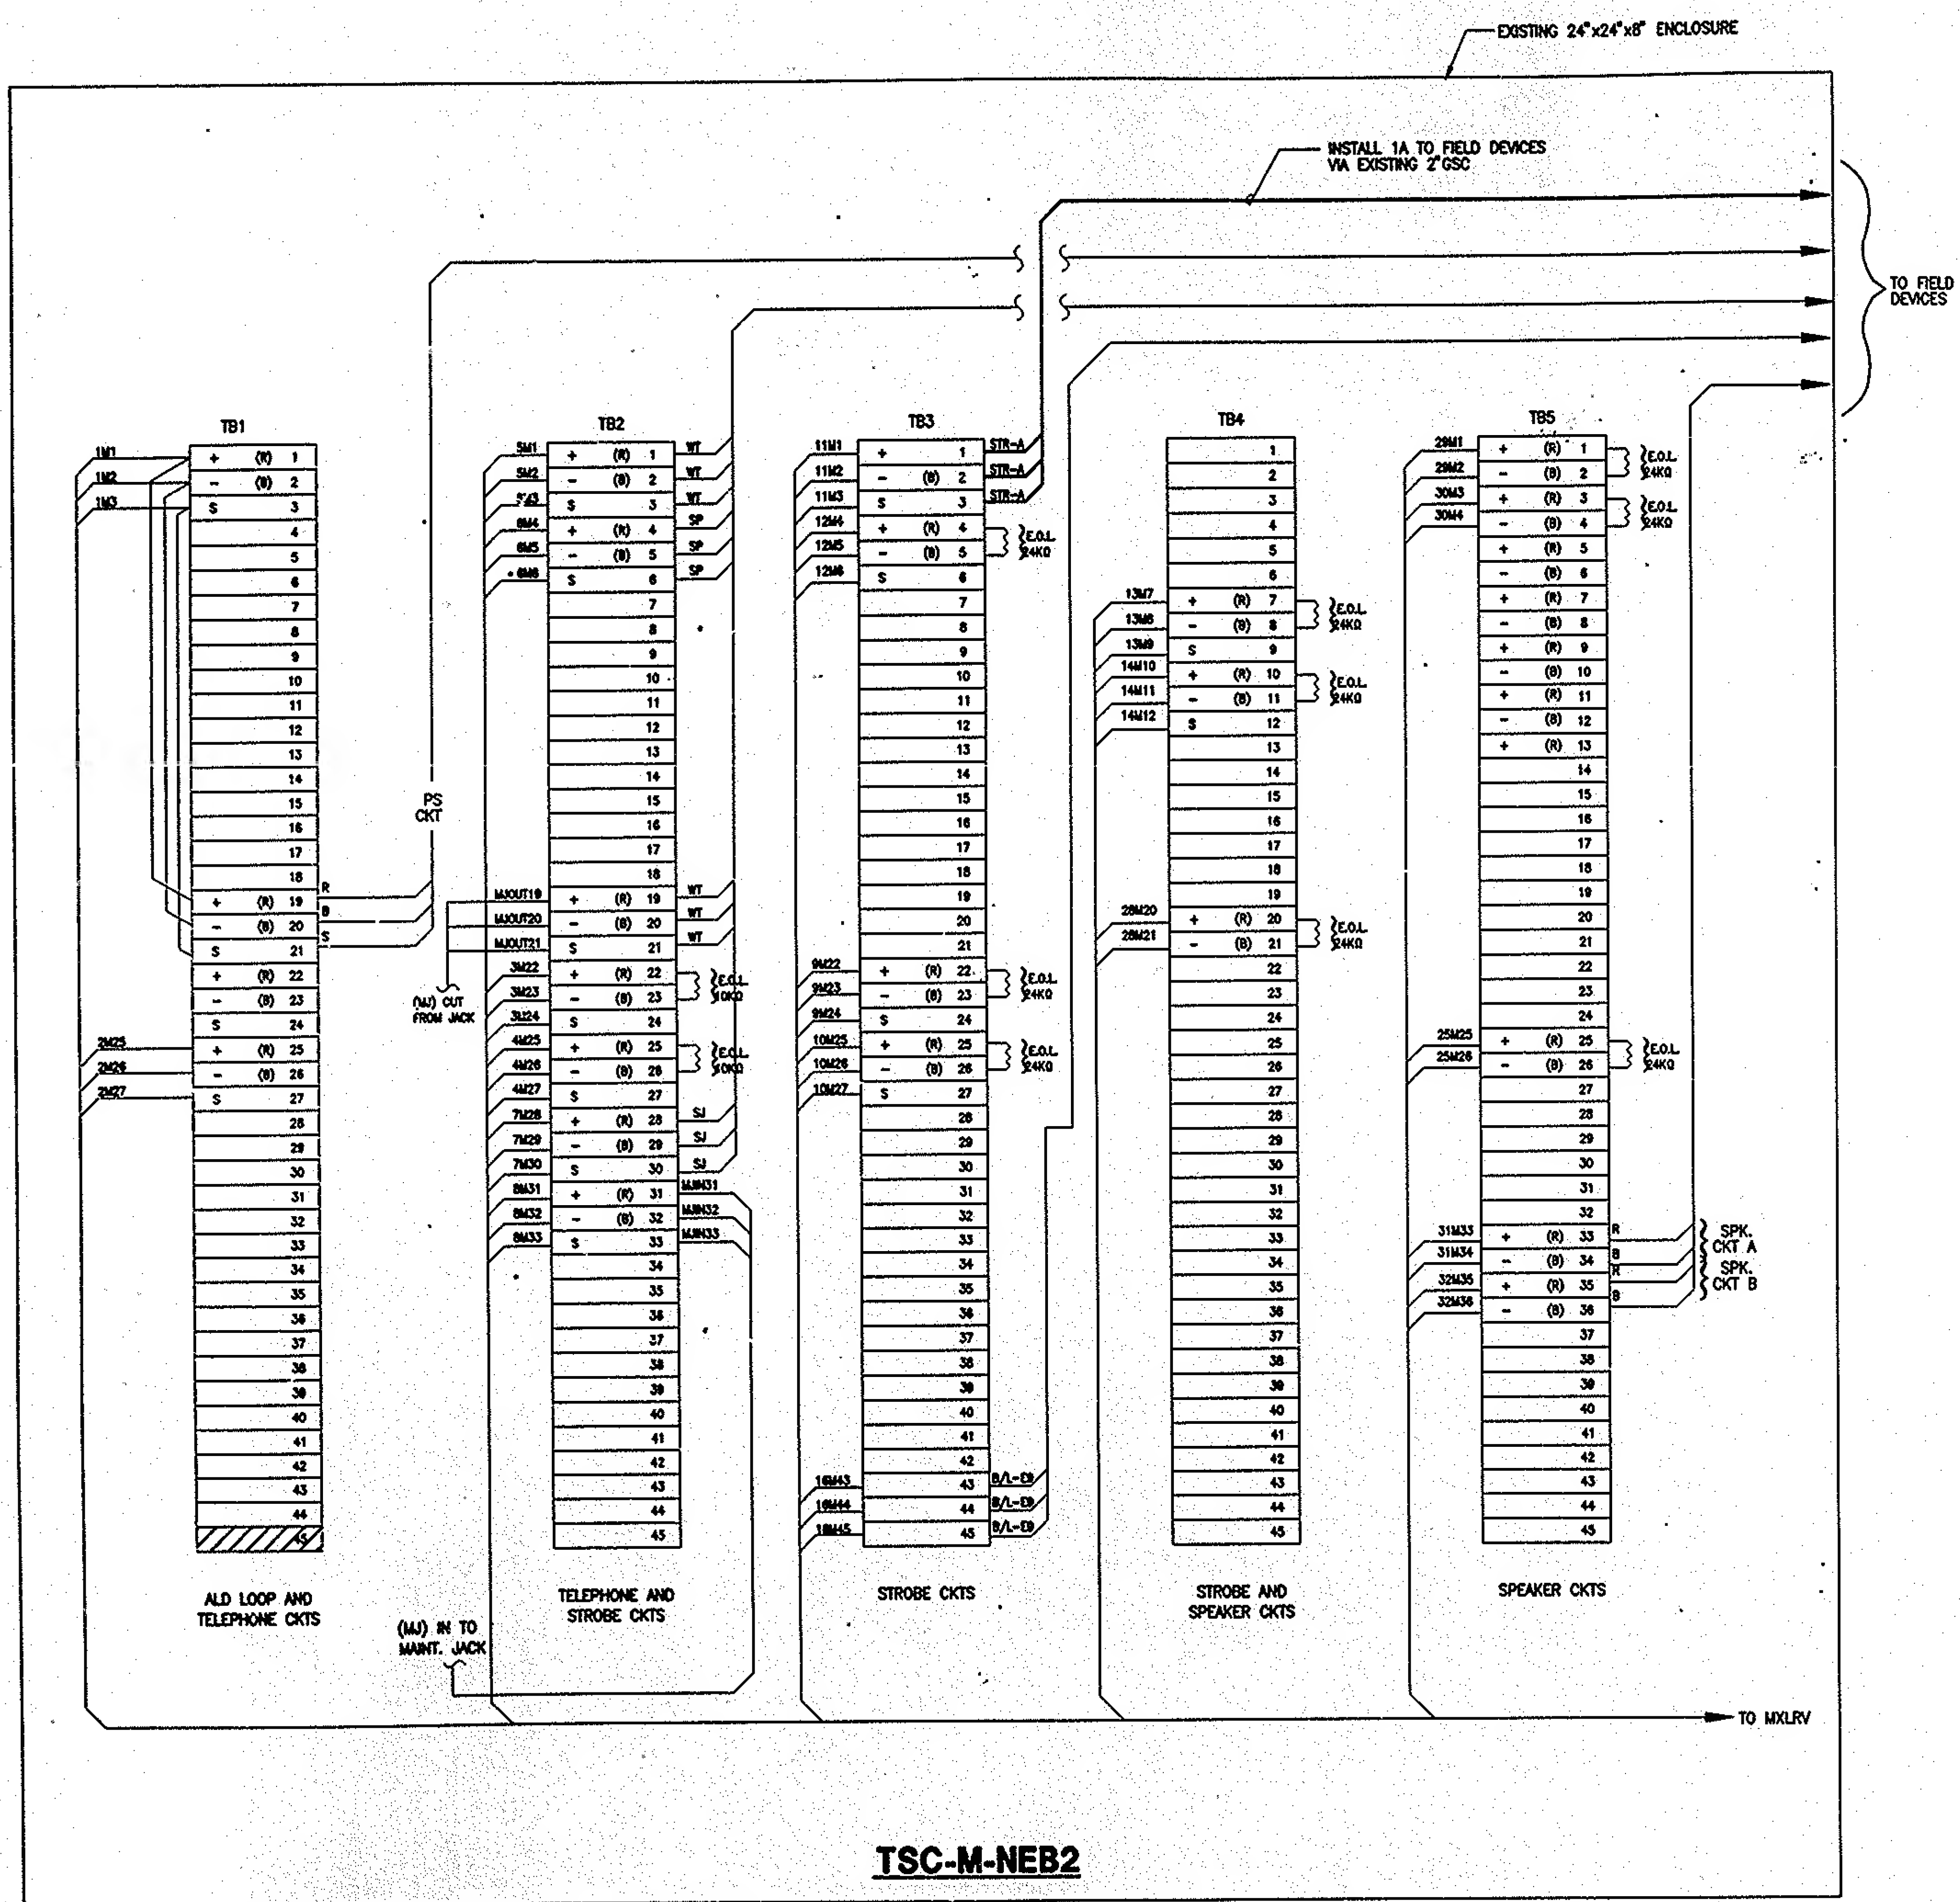

**NOTES:**


1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES SEE DRAWING TSC-M-NEB1.
2. ALL SHIELDS MUST BE ISOLATED FROM GROUND. TUBING SHALL BE USED ON ALL DRAIN CONNECTIONS (ON THIS DWG).
3. ALL WIRING SHALL BE FREE OF GROUND FAULTS AND STRAY VOLTAGES.
4. CONTRACTOR SHALL SHAPE, TEST AND LABEL CONNECTIONS. CONNECTION SHALL BE MADE BY CONTRACTOR AND UNDER THE DIRECT SUPERVISION OF THE PROJECT MANAGER.
5. FOR TSC-M-NEB2 ENCLOSURE LOCATION, SEE DRAWING TSC-M-NEB1.

**LEGEND:**

28M21  
#14 AWG CONDUCTOR  
28 - INDICATES PA  
M - INDICATES WH  
21 - INDICATES TE  
A - INDICATES WH  
P - INDICATES WH

TB2 - TERMINAL BLOCK  
(+) - INDICATES  
(-) - INDICATES  
(R) - INDICATES  
(S) - INDICATES  
(M) - INDICATES  
(A) - INDICATES  
(P) - INDICATES

UNUSED TERMINALS

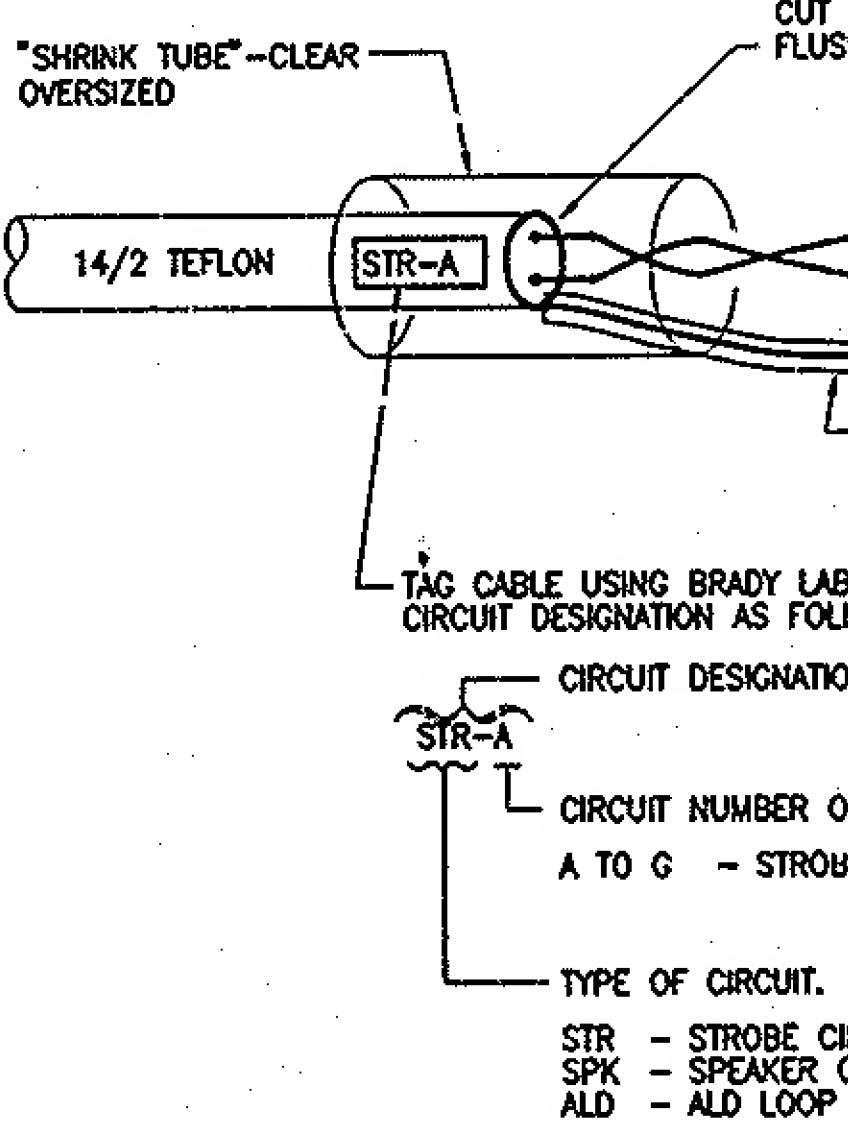

**DETAIL "A" - TYPICAL SHIELD/DR**